

**March 2015**

## **FREQUENTLY ASKED QUESTIONS**

### **Wiring Rules**

---

The new edition of the Australian/New Zealand Standard for Wiring Rules (AS/NZS 3000:2007) was released in November 2007 and revised by Amendment 1 in July 2009 and then revised by Amendment 2 in December 2012.

The amended edition of the Wiring Rules Standard is available in Australia from Standards Australia's distributor of Australian Standards, SAI Global at [www.saiglobal.com/shop](http://www.saiglobal.com/shop) or 131 242 and in New Zealand from Standards New Zealand at [www.standards.co.nz](http://www.standards.co.nz)

The following Frequently Asked Questions (FAQs) and answers have been developed by the committee responsible for the Wiring Rules (2007) and Amendment 1 and 2 to explain some of the issues which have been raised by users of the Standard.

Section	Clause/s and Heading/s
1	<p data-bbox="331 245 931 309"><b>FAQ 001/2009: AS/NZS 3000:2007—CLAUSE 1.9.3 1.9.3 ALTERATIONS, ADDITIONS AND REPAIRS</b></p> <p data-bbox="331 347 1939 411"><b>Question 001/2009.</b> When carrying out alterations and additions to electrical installations what requirements, other than those directly associated with the work, are required?</p> <p data-bbox="331 450 1890 545"><b>Answer.</b> If the alteration or addition is an improvement to the electrical installation protection techniques and satisfies Clause 1.9.3 Items (a) and (b), and Clause 2.6.3.4 then no additional work is required. NOTE: Examples are provided below for specific questions and answers to Clause 1.9.3.</p>
1	<p data-bbox="331 588 931 652"><b>FAQ 002/2009: AS/NZS 3000:2007—CLAUSE 1.9.3 1.9.3 ALTERATIONS, ADDITIONS AND REPAIRS</b></p> <p data-bbox="331 691 1581 754"><b>Question 002/2009.</b> If an existing item of electrical equipment is relocated, what requirements of AS/NZS 3000:2007 apply?</p> <p data-bbox="331 793 1980 959"><b>Answer.</b> If the only work is the relocation of the electrical equipment using existing conductors the requirements that would apply are the - (a) fixing and location of the electrical equipment; and (b) mechanical protection for the cables in the new location. However, if cables are renewed or extended, all the appropriate requirements such as mechanical protection, size, overcurrent protection and RCD protection are to be applied.</p>
1	<p data-bbox="331 1008 931 1072"><b>FAQ 003/2009: AS/NZS 3000:2007—CLAUSE 1.9.3 1.9.3 ALTERATIONS, ADDITIONS AND REPAIRS</b></p> <p data-bbox="331 1110 1460 1142"><b>Question 003/2009.</b> Is the replacement of an item of electrical equipment considered a repair?</p> <p data-bbox="331 1174 1236 1206"><b>Answer.</b> Yes. Provided it does not adversely affect the electrical installation.</p>
1	<p data-bbox="331 1244 931 1308"><b>FAQ 004/2009: AS/NZS 3000:2007—CLAUSE 1.9.3 1.9.3 ALTERATIONS, ADDITIONS AND REPAIRS</b></p> <p data-bbox="331 1347 1608 1378"><b>Question 004/2009.</b> If an additional item of electrical equipment is added to a circuit, what requirements of</p>

	<p>AS/NZS 3000:2007 would apply?</p> <p><b>Answer.</b> All the requirements deemed appropriate apply, including the following:</p> <p>(a) Any additional conductors must be of an appropriate size, have the correct relationship with a circuit protective device, and have mechanical protection.</p> <p>(b) Conditions on voltage drop must be met.</p> <p>(c) Conditions on fault-loop impedance and disconnection times must be met. (d) Compliance with Clause 2.2.1 on circuits.</p> <p>(e) Compliance with Clause 2.6 on additional protection by RCDs</p> <p>The exceptions to installing RCDs in accordance with Clause 2.6.3.5 apply.</p>
1	<p><b>FAQ 005/2009: AS/NZS 3000:2007—CLAUSE 1.9.3</b>  <b>1.9.3 ALTERATIONS, ADDITIONS AND REPAIRS</b></p> <p><b>Question 005/2009.</b> What requirements apply when a new circuit is installed?</p> <p><b>Answer.</b> All the requirements of AS/NZS 3000:2007 apply.</p>
1	<p><b>FAQ 009/2009: AS/NZS 3000:2007—CLAUSE 1.7 &amp; CLAUSE 2.9.3.1</b>  <b>1.7 SELECTION AND INSTALLATION OF ELECTRICAL EQUIPMENT</b>  <b>2.9.3.1 Construction—Access to live parts</b></p> <p><b>Question 009/2009.</b> What means could be used to identify an electrical switchboard or other electrical equipment that contains live parts in locations where additional attention should be given to the removal of covers and the like.</p> <p><b>Answer.</b> Australian Standard 1319—1994, <i>Safety signs for the occupational environment</i> specifies requirements for the design and use of safety-signs intended to warn of electrical and other occupational hazards. Table B3, Sign Number 447, is the symbolic electrical shock risk sign.</p>



The shock risk sign's effectiveness should be reinforced with a DANGER sign that, with an additional message of appropriate words, alerts persons to a particular life threatening hazard.

1

**FAQ 014/2009: AS/NZS 3000:2007—CLAUSE 1.9.3**

**1.9.3 MEANS OF COMPLIANCE - Alterations, additions and repairs**

**Question 014/2009.** When an addition is made to a circuit protected by a semi-enclosed rewirable fuse, under what conditions should the semi-enclosed rewirable fuse be replaced?

**Answer.**

*(a) Short-circuit protection*

The semi-enclosed rewirable fuse should be replaced with another type of protective device when the prospective short-circuit current is greater than 1 kA (e.g. change in distribution network).

*(b) Overload current protection*

The semi-enclosed rewirable fuse should be replaced with another type of protective device when the marked current rating of the fuse or fuse element is greater than 69% of the continuous current-carrying capacity of the cable ( $I_z$ ).

*(c) Degradation of the fuse base and/or carrier*

The semi-enclosed rewirable fuse should be replaced with another type of protective device when there is a visible significant deposition of carbon and/or copper on the fuse base or carrier.

1	<p><b>FAQ 015/2009: AS/NZS 3000:2007—CLAUSE 1.4.63</b>  <b>1.4.63 Live part</b></p> <p><b>Question 015/2009.</b> When a circuit is isolated by means of an isolating switch acting in all live (active and neutral) conductors is the neutral conductor downstream of the switch regarded as live?</p> <p><b>Answer:</b> No.</p>
1	<p><b>FAQ 018/2009: AS/NZS 3000:2007—CLAUSE 1.7.2 &amp; CLAUSE 2.9.2.5</b>  <b>1.7.2 INSTALLATION WORK PRACTICE</b>  <b>2.9.2.5 LOCATION OF SWITCHBOARDS- <i>restricted locations</i></b></p> <p><b>Question 018/2009.</b> Do the provisions of Clause 2.9.2.5 (c) apply to a switchboard installed within a service duct or shaft that provides access to building services such as telecommunications, data, power and similar in a multi-storey building?</p> <p><b>Answer.</b> No. For the purposes of Clause 2.9.2.5 (c) a service duct or shaft in a multi-storey building is not regarded as a cupboard or similar enclosure.  The location of a switchboard installed in a service duct or shaft is required to satisfy Clause 2.9.2.2 and access to the service duct or shaft should be restricted to authorized persons.</p>
2	<p><b>FAQ 016/2009: AS/NZS 3000:2007 – CLAUSE 2.6.3.2</b>  <b>2.6.3.2 Where additional protection is required – <i>Other electrical installations</i></b></p> <p><b>Question 016/2009.</b> Are circuits supplying only exit signs and emergency lighting required to be protected by an RCD?</p> <p><b>Answer:</b> No. They would be included in Exception 5 of this Clause since disconnection of the circuit by an RCD could cause a danger greater than earth leakage current.</p>
2	<p><b>FAQ 017/2009: AS/NZS 3000:2007—CLAUSE 2.6.3.4 &amp; CLAUSE 2.6.3.1</b>  <b>2.6.3.4 <i>Alterations, additions and repairs</i></b>  <b>2.6.3.1 <i>Residential electrical installations</i></b></p> <p><b>Question 017/2009.</b> Does the addition of a combination fan, light and heater unit, an exhaust ceiling fan or a ceiling sweep fan (with an unswitched socket outlet) to an existing lighting circuit without RCD protection need to be protected by an RCD?</p> <p><b>Answer:</b> No. For the purposes of Clause 2.6.3.1 combination fan, light and heating units, exhaust fans and ceiling sweep fans are all regarded</p>

	as lighting points.
2	<p><b>FAQ 026/2009: AS/NZS 3000:2007—CLAUSE 2.9.2.2</b>  <b>2.9.2.2 Location of switchboards – Accessibility and emergency exit facilities</b></p> <p><b>Question 026/2009:</b> Can the clearance of 600mm be achieved by removing the hinged door of a switchboard?</p> <p><b>Answer:</b> No. However, unhinged removable panels would satisfy the requirements</p>
2	<p><b>FAQ 028/2009: AS/NZS 3000:2007—CLAUSE 2.9.5.2</b>  <b>2.9.5.2 Equipment identification – Relationship of electrical equipment</b></p> <p><b>Question 028/2009:</b> What are the minimum marking requirements to satisfy this clause?</p> <p><b>Answer:</b> The protective devices for the circuits should be marked according to what they control and protect (eg CB1 - lights), and the geographical location of the equipment should be stated. (eg lighting - north western area of main office). This information, in the English language, should be on the switchboard or in the form of a permanently attached legend immediately adjacent to the switchboard.</p>
2	<p><b>FAQ 030/2009: AS/NZS 3000:2007—CLAUSE 2.9.2.2(c)(ii)</b>  <b>2.9.2.2(c) Location of switchboards – Accessibility and emergency exit facilities</b></p> <p><b>Question 030/2009:</b> What are the requirements for ‘sufficient exit facilities’ for large switchboards?</p> <p><b>Answer:</b> Normally the requirements would include two exits from the switchboard spaced well apart to allow a person to leave the vicinity of a switchboard under emergency conditions. However, where a clear space of three (3) metres is provided around the switchboard and its equipment, including switchboard doors, in all normal positions of operating, opening and withdrawal, only one exit need be provided. Note that three adjoining one metre switchboards are viewed as a three metre switchboard for the purposes of this clause.</p>
2	<p><b>FAQ 032/2009: AS/NZS 3000:2007—CLAUSE 2.6.3.4</b>  <b>2.6.3.4 Where additional protection is required – Alterations, additions and repairs</b></p> <p><b>Question 032/2009:</b> Can a socket–outlet added to an existing circuit be protected by an RCD incorporated into the socket–outlet?</p> <p><b>Answer:</b> Yes, although it is preferable to locate the RCD in the switchboard to protect the complete circuit rather than installing an RCD that protects only the individual socket-outlet.</p>

	<p>NOTE: Double pile required for S/O RCDs – for line-thru and control (RC) of additional downstream S/O</p>
<p>2</p>	<p><b>FAQ 038/2011: AS/NZS 3000:2007 – CLAUSE 2.6.3.2</b>  <b>2.6.3.2 Where additional protection is required – Other electrical installations</b></p> <p><b>Question 038/2011:</b> Are circuits supplying only exit signs and emergency lighting required to be protected by an RCD?</p> <p><b>Answer:</b> Installing an RCD is not mandatory for these circuits. Exception 5 of this clause may be applied as disconnection of the circuit by an RCD could cause a danger greater than earth leakage current.</p>
<p>3</p>	<p><b>FAQ 006/2009: AS/NZS 3000:2007—CLAUSE 3.7.2.1.2</b>  <b>3.7.2.1.2 ELECTRICAL CONNECTIONS—Connection methods—General</b></p> <p><b>Question 006/2009.</b> What factors need to be considered when connecting aluminium conductors?</p> <p><b>Answer.</b> It is recommended that literature provided by manufacturers of aluminium cables and components designed for the connection of aluminium conductors be consulted to determine the appropriate techniques to use.  Some of the techniques used in the jointing or termination of aluminium conductors are as follows: (a) The use of purpose designed bi-metallic cable lugs and other connection devices.  (b) Welding, which may be used for solid or stranded conductors.  (c) Soldering of solid conductors, utilizing special solders which scratch remove the aluminium oxide and tin the conductors.  (d) Soldering of stranded conductors, utilizing special fluxes to remove the aluminium oxide and the use of solder basting techniques to tin the conductors.  (e) Crimping, indenting or compression of solid or stranded conductors using cable lugs or ferrules made of aluminium and designed for the purpose.  (f) Removal of the aluminium oxide from contact surfaces by applying an oxide-inhibiting compound and leaving it in place to prevent the ingress of moisture and air to the completed joint.  (g) Bolting or clamping terminations using aluminium alloy bolts and nuts that expand or contract at the same rate as the conductor and cable lug.  (h) Using spring cup washers of the ‘Belleville’ type, which when properly selected will compensate for any differential expansion of the aluminium conductor and other metals in the joint.  (i) Tunnel type terminals specifically designed to evenly distribute stress on conductors.</p>

	<p>Consideration needs to be given to the following:</p> <ul style="list-style-type: none"> <li>(i) Removal of the aluminium oxide film, which prevents good electrical contact, from the conductors.</li> <li>(ii) Avoiding contact with dissimilar metals that may initiate galvanic action</li> <li>(iii) The different coefficient of linear expansion of aluminium and other metals that, when connected together may over time, due to expansion and contraction, result in loose connections.</li> <li>(iv) The relative softness of aluminium, which when compressed may cause the metal to ‘flow’ away from the connection resulting in a high resistance connection.</li> </ul>
3	<p><b>FAQ 007/2009: AS/NZS 3000:2007—CLAUSE 3.8 &amp; TABLE 3.4 &amp; CLAUSE 5.2.2</b></p> <p><b>3.8 IDENTIFICATION</b></p> <p><b>TABLE 3.4 CONDUCTOR COLOURS FOR INSTALLATION WIRING</b></p> <p><b>5.2.2 EARTHING FUNCTIONS—Functional earthing (FE)</b></p> <p><b>Question 007/2009.</b> If an RCD is provided with a functional earthing conductor (typically coloured white or pink), may this conductor be connected to an earthing terminal/connection or bar?</p> <p><b>Answer.</b> Yes. The purpose of the conductor is to allow a return path for the electronic circuit, if the neutral is disconnected, to ensure the RCD still operates correctly. The conductor does not perform a protective earth function.</p>
3	<p><b>FAQ 034/2010: AS/NZS 3000:2000—CLAUSE 1.5.5.3 (c), CLAUSE 3.6.2, CLAUSE 8.3.9, B2, B5 AND C4</b></p> <p><b>1.5.5.3(c) Fault protection (Protection against indirect Contact)—<i>Protection by automatic disconnection of supply—Earthing system impedance (earth fault-loop impedance)</i></b></p> <p><b>3.6.2 VOLTAGE DROP—Value</b></p> <p><b>8.3.9 TESTING—Verification of impedance (earth fault-loop impedance)</b></p> <p><b>Question 034/2010.</b> When existing circuits are extended or new circuits installed, what limiting factors affect the length of the circuit?</p> <p><b>Answer.</b> Limiting factors include voltage drop and fault-loop impedance. Table B1 provides maximum route lengths based on fault-loop impedance and Clause C4 provides information on voltage drop. Table C7 provides a simple method for estimating the voltage drop for various conductor sizes.</p> <p>The table below gives calculations of circuit lengths based on voltage drop. The figures in <b>bold</b> indicate where the voltage drop is the limiting factor. If the figures are in <i>italics</i> then the length should be based on the values of the earth loop impedance.</p>



### Comparison of circuit route length based on loop impedance and various voltage drops

Circuit breaker rating $I_N$	Phase and neutral	Earth	Circuit length based on Table B 5.1 Type C MCB <sup>a</sup>	Circuit length based on Volt drop 1 phase (active plus neutral) <sup>b</sup> (Max 5% of 230V)							
				5% VD at rated current <sup>c</sup>	5% VD on distributed circuit <sup>c</sup>	4% VD at rated current <sup>c</sup>	4% VD on distributed circuit <sup>c</sup>	3% VD at rated current <sup>c</sup>	2.5% VD at rated current <sup>c</sup>	1.0% VD at rated current <sup>c</sup>	1.0% VD on distributed circuit <sup>d</sup>
A	mm <sup>2</sup>	mm <sup>2</sup>	m	m	m	m	m	m	m	m	m
6	1	1	91	37	82	30	66	22	19	7	16
10	1	1	55	22	49	18	40	13	11	4	10
10	1.5	1.5	82	35	77	28	62	21	17	7	15
16	1.5	1.5	51	22	48	17	38	13	11	4	10
16	2.5	2.5	85	40	88	32	71	24	20	8	18
20	2.5	2.5	68	32	71	26	56	19	16	6	14
25	4	2.5	67	41	91	33	73	25	21	8	18
32	4	2.5	52	32	71	26	57	19	16	6	14
40	6	2.5	48	38	85	31	68	23	19	8	17
50	10	4	62	52	114	41	91	31	26	10	23
63	16	6	76	65	144	52	115	39	33	13	29
80	16	6	59	51	113	41	91	31	26	10	23
80	25	6	66	80	178	64	142	48	40	16	36
100	25	6	53	64	142	51	114	39	32	13	28
100	35	10	85	89	195	71	156	53	44	18	39
125	35	10	68	71	156	57	125	43	36	14	31
125	50	16	106	95	209	76	167	57	47	19	42
160	50	16	83	74	163	59	130	44	37	15	33
160	70	25	126	104	228	83	183	63	52	21	46
200	70	25	100	83	183	67	146	50	42	17	37

<sup>a</sup> Earth fault loop lengths are for Type C MCB, 400ms. For type B MCB multiply length x 1.875. For Type D MCB multiply length x 0.6. <sup>b</sup> Circuit length based on voltage drop. If in **bold**, Voltage Drop is the limiting figure; if in *italics*, use *length* based on earth fault-loop impedance.  
<sup>c</sup> Calculations are based on resistance of cable at 75°C. The resistance at 20°C (for testing cold)=resistance at 75°C x 0.8.  
<sup>d</sup> Distributed circuits (for example multiple socket-outlet circuits). Calculations are based on Clause 3.6.2 (IN/2, where cable is deemed to be carrying half the rated current of the circuit-breaker) and resistance of cable at 45°C.

3

**FAQ 021/2009: AS/NZS 3000:2007—CLAUSE 1.5.14, CLAUSE 3.9.4 & CLAUSE 3.9.4.4**

**1.5.14 Protection against external influences**

**3.9.4 Protection against mechanical damage**

**3.9.4.4 Protection methods**

**Question 021/2009.** What types or methods of protection are regarded as adequate to prevent mechanical damage in accordance with Clause 3.9.4?

**Answer.** The provisions of Clause 3.9.4 are intended to protect wiring systems installed in locations where they may reasonably be expected to be subject to mechanical damage such as a screw or nail penetrating the surface of the structure containing the electrical installation.

The method of protection of the wiring system may be any one of the three detailed in Clause 3.9.4.4. These three methods are: Clause 3.9.4.4 (a) that requires prevention of mechanical damage to the wiring system.

The form of mechanical protection must be such as would **prevent** a screw or nail etc penetrating the wiring system and should take into account the material and type of wall structure together with the type of tool likely to be used to insert a screw or nail into the surface (i.e. solid brick, plasterboard lining, concrete slab etc).

If there remains a risk that the wiring system could be penetrated after the installation of the mechanical protection, the risk has not been prevented and either sub-clause (b) or (c) must be applied.


Clause 3.9.4.4 (b) that requires the use of an armour, screen, covering or enclosure that is earthed to ensure that in the event of penetration of the wiring system the circuit protective device will operate.

Metallic barriers, such as sheet metal, wall boxes and the like shall be earthed by means of a conductor having a size not less than that required for the largest associated circuit.

Clause 3.9.4.4 (c) that requires the use of an RCD to provide additional electrical protection that obviates the need for the forms of additional

	<p>mechanical protection detailed in (a) and (b).</p> <p>It should also be noted that Clause 3.3.2.6 requires wiring systems to be arranged to minimize the risk of mechanical damage. Therefore suitable location of the system such that the risk does not exist should always be the first choice. For example, a wiring system installed within the cavity of a double brick cavity wall would not be considered at risk of mechanical damage.</p> <p>Wiring systems installed in an internal cavity wall where there is a cupboard or similar enclosure permanently installed in such a manner as to preclude the risk of penetrating the wall cavity would not be regarded as being at risk provided that the wiring is more than 50mm from the opposite (exposed) surface of the wall. For example, a cupboard arranged to form a duct of at least 50mm between the wall and the rear of the cupboard such as one above a wall oven arranged to provide for the dissipation of heat generated by the oven. (The 50mm could include the thickness of the wall surface.)</p>
3	<p><b>FAQ 013/2009: AS/NZS 3000:2007—CLAUSE 3.11 AND TABLE 3.5</b>  <b>3.11 UNDERGROUND WIRING SYSTEMS</b>  <b>TABLE 3.5 UNDERGROUND WIRING SYSTEM CATEGORIES</b></p> <p><b>Question 013/2009.</b> What distinguishes a neutral screened cable suitable to be buried direct in the ground without mechanical protection from other neutral screened cables?</p> <p><b>Answer.</b> A neutral screened cable with a sheath of at least 3.2 mm thickness, marked "UNDERGROUND" and complying with AS/NZS 4961.</p>
3	<p><b>FAQ 019/2009: AS/NZS 3000:2007—CLAUSE 3.6.2</b>  <b>3.6.2 VOLTAGE DROP – Value</b></p> <p><b>Question 019/2009.</b> Is the 7% voltage drop applicable to rural type installation (e.g. homestead, shearing shed, other accommodation, irrigation pumps, etc)?</p> <p><b>Answer.</b> Yes. Provided the transformer is dedicated to the installation</p>
3	<p><b>FAQ 020/2009: AS/NZS 3000:2007—CLAUSE 3.9.7.1.2</b>  <b>3.9.7.1.2 Particular requirements Consumers mains - Unprotected</b></p> <p><b>Question 020/2009.</b> In addition to the wiring systems identified in items (i) to (iv), under what conditions would an unenclosed, insulated and sheathed cable be permitted as unprotected consumers mains for installations?</p>

	<p><b>Answer.</b> Subject to any additional requirements or restrictions of the electricity distributor, the following installation conditions for an insulated and sheathed cable are deemed to minimise the risk of short– circuit:</p> <p>(a) Installed in areas that would not be subject to mechanical damage (see Clause 3.9.4), for example –</p> <p>(i) supported more than 50mm from surfaces in a roof space that may be penetrated by nails, screws or drills and in a location not subject to damage by access within the roof space</p> <p>(ii) run in double brick or brick veneer wall cavities; or</p> <p>(iii) supported by cable trays or ladders or at the point of attachment at a height of not less than 2.5m from the ground, floor or platform (out of arms reach);</p> <p>and,</p> <p>(b) Additional mechanical protection of the cable, by insulating, enclosing or installing barriers, at any points along the mains likely to be damaged due to movement, for example where the cable passes through or contacts abrasive building materials or for any other reason.</p> <p>Additional requirements may be applied by various States in Australia.</p>
3	<p><b>FAQ 022/2009: AS/NZS 3000:2007—CLAUSE 3.12.3.2</b>  <b>3.12.3.2 Clearances – Safety warnings</b></p> <p><b>Question 022/2009:</b> What are suitable devices or notices for safety warnings near aerial conductors?</p> <p><b>Answer:</b> The warning notice should be located on each electricity pole. The signs should have the same dimensions and colours as those listed in AS 1319. Some examples of signs are given below for use on waterways. For general use the yellow diamond could be replaced by the danger sign (below) and the wording suitably modified.</p>

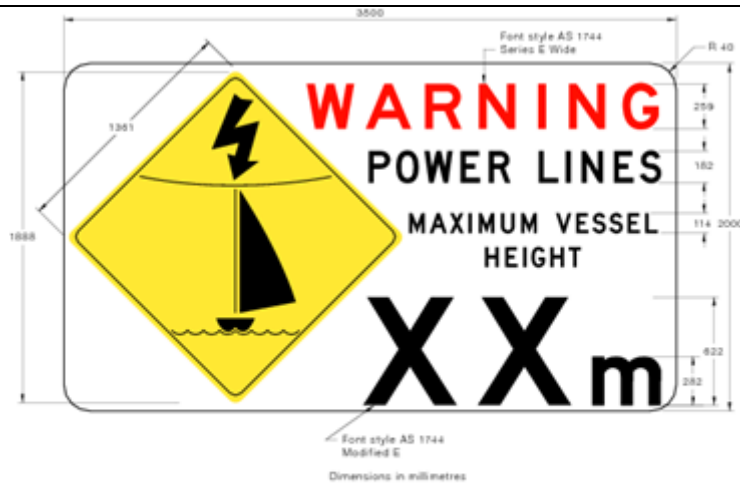

Font style Series D Medium UNO in accordance with AS 1744

Colours  
Red R03-Signal Red (PMS 186C, 1795U) in accordance with AS 2700  
Yellow Y19-Sunflower (PMS 136C, 119U) in accordance with AS 2700  
Black 00503 in accordance with SS 5252  
White 00E55 in accordance with SS 5252



Font style Series D Medium UNO in accordance with AS 1744

Colours  
Yellow Y19-Sunflower (PMS 136C, 119U) in accordance with AS 2700  
Black 00503 in accordance with SS 5252  
White 00E55 in accordance with SS 5252



3	<p><b>FAQ 023/2009: AS/NZS 3000:2007 – CLAUSE 3.11.5 CLAUSE 3.9.8.4 TABLE 3.7</b>  <b>3.11.5 SPACING FROM OTHER UNDERGROUND SERVICES</b>  <b>3.9.8.4 Proximity to non-electrical services</b>  <b>TABLE 3.7 MINIMUM SEPARATION OF UNDERGROUND SERVICES</b></p> <p><b>Question 023/2009:</b> Are the separation distances in Table 3.7 only required for services using metallic pipelines?</p> <p><b>Answer:</b> No. The separation between services (Column 2) applies to all situations (metallic and insulating pipes). The distance from the earth electrode (Column 3) applies only to metallic pipelines.</p>
3	<p><b>FAQ 029/2009: AS/NZS 3000:2007—CLAUSE 3.10.3.1</b>  <b>3.10.3 Installation of wiring enclosures – General</b></p> <p><b>Question 029/2009:</b> May a wiring system be placed within a concrete path?</p> <p><b>Answer:</b> No. A wiring enclosure placed within a concrete path does not satisfy the requirements for underground wiring and is not considered to be ‘safe and sound practice’ and does not provide adequate protection.</p>
3	<p><b>FAQ 37/2010: AS/NZS 3000:2007—CLAUSE 3.8.2</b>  <b>CLAUSE 3.8.2 IDENTIFICATION – Colour identification by sleeving or other means</b></p> <p><b>Question 37/2010:</b>  What colour identification of conductors can be changed by sleeving?</p> <p><b>Answer:</b> Conductors may be sleeved for use as either neutral or active conductors with the exception of insulated conductors coloured green, yellow or green/yellow.</p> <p>Specifically green, yellow or green/yellow insulated conductors are reserved for use as earthing conductors and are not permitted to be sleeved, identified or used as active or neutral conductors.</p> <p>Single-core cables of other colours may be sleeved for use as earthing conductors only where they are sleeved continuously with green/yellow material along their entire length.</p> <p>A green coloured insulated conductor need not be coloured green/yellow for use as an earthing conductor.</p>

	<p>Colour identification requirements apply to the colour of the basic insulation of a conductor.</p>
4	<p><b>FAQ 033/2010: AS/NZS 3000:2007—CLAUSE 4.4.2.2(d)</b>  <b>CLAUSE 4.4.2.2 Location – Protection of socket-outlets</b></p> <p><b>Question 033/2010:</b> Can a socket–outlet for the connection of a fixed or stationary appliance or luminaire be installed without fixing to a structure or support?</p> <p><b>Answer:</b> Yes provided that the installation satisfies the following:</p> <ul style="list-style-type: none"> <li>(a) Clause 3.7.2.6 – no undue mechanical stress on any connection</li> <li>(b) Clause 3.9.3.3 - the wiring is <b>unlikely</b> to be disturbed</li> <li>(c) Clause 3.9.3.2 – adequate support provided by the suspended ceiling</li> <li>(d) Clause 3.10.1.1 – unsheathed cables shall be enclosed</li> <li>(e) Clause 3.10.1.2 – where the sheath is removed the exposed cores must satisfy Clause 3.10.1.1</li> <li>(f) Clause 4.1.2(d) – no danger from electric shock, fire, high temperature or physical injury in the event of reasonably expected conditions of overload, abnormal operation, fault or external influences.</li> </ul>
5	<p><b>FAQ 010/2009: AS/NZS 3000:2007—</b></p> <p>Clause 5.3.5.2 EARTHING SYSTEM PARTS—MEN Connection—Size  Clause 5.4.5 EARTHING OF EQUIPMENT—Conductive supports for aerial conductors  Clause 5.5.3.5 EARTHING ARRANGEMENTS—Particular methods of earthing unprotected consumer’s mains</p> <p><b>Question 010/2009.</b></p> <ul style="list-style-type: none"> <li>a) In switchboards that are rated at less than 800A per phase, why are bonding conductors that are connected to exposed conductive parts that are associated with unprotected consumer’s mains such as switchboard surrounds and riser brackets etc. required to be of a cross-sectional area not less than the main neutral conductor? (Clause 5.5.3.5 &amp; Clause 5.4.5)</li> <li>b) Why must the MEN connection associated with unprotected consumers mains required to be of a cross-sectional area not less than the main neutral conductor? (Clause 5.3.5.2)</li> <li>c) When can the electrical installation earthing system be used?</li> </ul>

**Answer.**

(a & b) In the case of unprotected consumer's mains, any conductor that forms part of the earth fault loop for the unprotected consumer's mains must have a capacity not less than that of the main neutral conductor.

A short circuit of an unprotected active conductor to a switchboard surround, riser bracket etc. will cause the bonding conductor and the MEN to carry the maximum fault current available through those consumers mains.

A bonding conductor of equivalent capacity to the main neutral conductor would -

- (a) Provide a reasonable chance for any upstream short circuit network system protective devices (i.e. at distribution transformer) to operate; and
- (b) Limit the amount of damage to the consumers earthing system; and
- (c) Maintain the integrity of the MEN connection.

(c) The electrical installation earthing system can be used where -

- (i). the switchboard/meter enclosure, riser bracket etc. is earthed by a bonding conductor connected to the main neutral conductor in accordance with Clause 5.5.3.5(a); or
- (ii). double insulation is maintained to the service protective device on the switchboard/meter enclosure.

In these situations, the MEN connection is not required to carry earth fault current arising from the consumers mains and hence may have a cross-sectional area not less than the main earthing conductor in accordance with Exception (b) or (c) to Clause 5.3.5.2.

**Examples:**


Figure 10.1. When double insulation of consumer's mains is maintained to the service protective device on the switchboard/meter enclosure then the enclosure may be earthed to the electrical installation earthing system with a protective earthing conductor sized in accordance with Clause 5.3.3.1.2 for the largest single insulated active conductor within the enclosure.

Figure 10.2 shows an example using unprotected consumers mains having sheathing that is not maintained to the service protective device, with the enclosure earthed by direct connection to the main neutral conductor. In this example the MEN connection does not form part of the earth fault loop for the enclosure.

Figure 10.3 shows an example using unprotected consumers mains without sheathing, with the enclosure earthed by connection to the earth bar. In this example the MEN connection must have a cross-sectional area not less than that of the main neutral conductor in accordance with the second paragraph of Clause 5.3.5.2 as it forms part of the earth fault loop for the enclosure.



5	<p><b>FAQ 011/2009: AS/NZS 3000:2007—</b></p> <p>CLAUSE 5.6.2.6.2 EQUIPOTENTIAL BONDING—Arrangement—Swimming and spa pools- Conductive fixtures and fittings          CLAUSE 6.3.3.2 SWIMMING POOLS, PADDLING POOLS AND SPA POOLS OR TUBS— Protection against electric shock—          Supplementary equipotential bonding</p> <p><b>Question 011/2009.</b>  <b>Do extraneous conductive parts such as a pool fence, which are located inside Zone 1 or Zone 2 surrounding a pool, but beyond arm’s reach of the pools edge, require equipotential bonding?</b></p> <p><b>Answer.</b>          No. Clause 6.3.3.2 requires extraneous conductive parts within Zone 1 or Zone 2 to be bonded in accordance with Clause 5.6.2.6. However Clause 5.6.2.6.2 excludes any conductive material that is outside of the dimensions of “Arms Reach”          Refer to Clause 1.4.12 for the dimensions of arms reach.</p>
5	<p><b>FAQ 012/2009: AS/NZS 3000:2007—CLAUSE 5.5.3.5</b>  <b>5.5.3.5 EARTHING ARRANGEMENTS—Particular methods of earthing—Unprotected consumers mains</b></p> <p><b>Question 012/2009.</b> What are considered to be unprotected consumers mains in accordance with AS/NZS 3000:2007?</p> <p><b>Answer.</b> Unprotected consumers mains are those that are not protected by a Service Protective Device (SPD) as shown in the following sketch.</p>

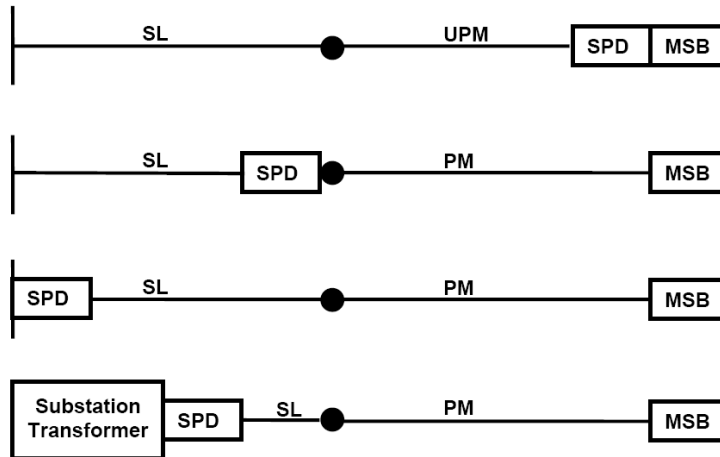

**Legend**

- SPD Service protective device – provides short-circuit protection but not necessarily overload and earth fault protection
- MSB Main switchboard
- Point of supply
- SL Service line
- PM Protected consumers mains
- UPM Unprotected consumers mains

5

**FAQ 024/2009: AS/NZS 3000:2007—**

CLAUSE 5.6.2.5 EQUIPOTENTIAL BONDING – Arrangement – Showers and bathrooms

**Question 024/2009:**

(a) Is it a requirement for the connection of the equipotential bonding conductor to be accessible?

	<p>(b) Is it acceptable to run the conductive reinforcing system bonding conductor to a part of the equipotential bonding system outside of the room involved?</p> <p>(c) Is it acceptable, where the conductive reinforcing system is electrically continuous, for the conductive reinforcing system to be exposed above the slab, in one location only, and earthed to the earth bar within a switchboard, if the connection within the switchboard is suitably labeled?</p> <p>(d) In instances where there are multiple dwellings on one slab on the same level, is it acceptable, where the conductive reinforcing system is electrically continuous, for the conductive reinforcing system to be exposed above the slab, in one location only, and to be connected to the earth bar within the switchboard that provides electricity supply to the dwellings?</p> <p><b>Answer:</b></p> <p>(a) No. The requirements of the clause are similar to the requirements for equipotential bonding in the case of swimming and spa pools where the equipotential bonding connection is not specifically required to be accessible. (See Clause 5.6.2.6.)</p> <p>(b) Yes. The bonding conductor may be connected to any part of the earthing system.</p> <p>(c) Yes</p> <p>(d) Yes, provided that the following requirement is considered</p> <p style="padding-left: 40px;">a. The installed protective earth shall not cause a parallel path as described in Clause 5.5.3.1 (b) (vi)</p>
5	<p><b>FAQ 025/2009: AS/NZS 3000:2007—</b>  <b>CLAUSE 5.6.2.5 Arrangement – Showers and bathrooms</b>  <b>Question 025/2009:</b>  <b>What methods may be used to connect the reinforcing within the concrete floor to the earthing system?</b></p> <p><b>Answer:</b>  Several commercial products are available to enable effective equipotential bonding to the reinforcing mesh. One option (see picture below) is to have a conductive steel rod (rebar) that is tied to the electrically continuous steel reinforcing mesh that includes the shower or bathroom, bent up in the wall cavity below the meter position.  A minimum 4mm equipotential bonding conductor is then connected between the main earthing conductor, bar or link located at the main switchboard and the rod. Alternatively the bonding conductor can be connected to any other part of the earthing system.  Alternatively a minimum 4mm equipotential bonding conductor may be connected via a suitable clamping device directly to the steel</p>

reinforcing within the concrete slab

Whilst the bonding does not rectify any high resistance in the PEN conductor, it does bond the conductive floor to any other conductive material or equipment within the bathroom and prohibit any voltage differences that might otherwise arise.



5

**FAQ 031/2009: AS/NZS 3000:2007—**

CLAUSE 5.4.6.2 Structural metalwork including conductive building materials – *Domestic electrical installations*

**Question 031/2009:**

**Is it necessary to earth individual lintels, posts, metal window frames and steel trusses mounted on timber walls?**

**Answer:**

No, however in the case of unearthed structural metalwork and other conductive building materials the following must be considered

- a) There shall be no risk of contact between insulated unsheathed cables coming into contact with the building material and,
- b) There shall be no risk of contact between live parts of electrical equipment and the building material
- c) The breaking of a conductor at a termination or connection shall not result in the above mentioned contacts from occurring. (this can be achieved by shrouding, tying, restraining, lacing or clipping)

5

**FAQ 36/2010: AS/NZS 3000:2007—CLAUSE 5.3.3.2**

**CLAUSE 5.3.3.2 Earthing conductor size (cross-sectional area) – Main earthing conductor**

**Question 36/2010:**

Where the main earthing conductor forms part of the earth fault current path and its size needs to be determined based on the prospective fault current level and duration what sizes are required in the following two examples?

Example A - An installation with consumers mains having a nominated fault current level of 25kA where the disconnection time of the overcurrent protective device is not available (The earthing conductor will not be laid up with other cables and will have PVC insulation)

Example B – calculate the size required if the nominated fault current is reduced to 15kA and the protective device has a disconnection time of 0.4 seconds.

**Answer:**

If the disconnection time of the overcurrent protective device cannot be determined, the disconnection time shall be deemed to be 0.2 second. The 0.2 second disconnection time is intended to apply where the upstream overcurrent protective device is supplied or installed by a distributor and its characteristics are not available or where no such device is installed.

Example A - From the formula

$$S = \frac{I^2 t}{K^2}$$

*I* is the nominal short circuit current (25kA)

*t* is the disconnection time – unspecified so use the deemed value of 0.2 seconds

*K* has a value of 136 (for PVC insulated conductors)

**So S = 82 square millimetres (use 95 mm<sup>2</sup> conductor)**

Example B –

*I* is the nominal short circuit current (15kA)

*t* is the disconnection time – 0.4 seconds

*K* has a value of 136 (for PVC insulated conductors)

	<b>In this case S = 70 square millimetres (use 70 mm<sup>2</sup> conductor)</b>
5	<p><b>FAQ 39/2011: AS/NZS 3000:2007—</b>  <b>CLAUSE 5.5.5.5 EARTHING ARRANGEMENTS—Installation—Buried earthing conductors</b>  <b>Question 39 /2011.</b></p> <p>(a) What depth of burial requirements apply to bare earthing conductors and bare equipotential bonding conductors buried direct in the ground or installed in an underground wiring enclosure.</p> <p>(b) What conditions apply where insulated conductors are substituted for the bare conductors?  (b) When is a conductor forming part of an earthing grid, regarded as an earthing conductor and when is it an earthing electrode?</p> <p><b>Answers.</b></p> <p>(a) Bare or insulated earthing conductors which are buried directly in the ground shall be in accordance with the requirements of Clause 3.11 and be provided with protection appropriate to the expected conditions of mechanical damage at the point of installation (see Clause 5.5.5.2).</p> <p>(b) Where the installation of bare conductors would meet the requirements of Clause 5.5.5.5 and insulated conductors are substituted for the bare conductors (e.g. by choice of design, to provide added protection against corrosion, due to availability of suitable material or other such reason) then the installation of the insulated conductors need only comply with the requirements applicable to the bare conductors.</p> <p>(c) A bare earthing conductor which is not a part of any underground wiring system may be used as a strip-type earth electrode and buried in a horizontal trench in accordance with Clause 5.3.6.</p>
6	<p><b>FAQ 008/2009: AS/NZS 3000:2007—CLAUSE 6.3.4 and CLAUSE 7.5</b>  <b>6.3.4 SWIMMING POOLS, PADDLING POOLS AND SPA POOLS OR TUBS - Selection and installation of electrical equipment</b>  <b>7.5 EXTRA-LOW VOLTAGE ELECTRICAL INSTALLATIONS</b></p> <p><b>Question 008/2009.</b> May the power supply for electrical equipment, such as luminaires, intended for installation in Zone 0 be designed for an output voltage above the nominal voltage to allow for a voltage drop in the cables between the power supply and the equipment?</p> <p><b>Answer.</b> No. The power supply is to be designed for the nominal voltage of 12 V a.c. or 30 V ripple-free d.c.</p>
6	<p><b>FAQ 027/2009: AS/NZS 3000:2007—CLAUSE 6.2.2</b>  <b>6.2.2 BATHS, SHOWERS AND OTHER FIXED WATER CONTAINERS – Classification of zones</b></p>

	<p><b>Question 027/2009:</b> When the fixed shower plumbing connection is located above 2.5 m height does it remain in Zone 1?</p> <p><b>Answer:</b> Yes. See classification of zones in Clause 6.2.2.1(b)(vi) and 6.2.2.1(c)(v)</p>
7	<p><b>FAQ 35/2010 – CLAUSE 7.2.7.2</b>  <b>CLAUSE 7.2.7.2 Wiring systems – Type of wiring</b></p> <p><b>Question 35/2010:</b> May Exception (A) to Clause 7.2.7.2 be applied to the type of wiring system used for consumers mains supplying safety services where such mains are installed within a switchroom that is constructed to provide a fire rating of at least 2 hours?</p> <p><b>Answer:</b> No. The Exception applies to wiring system enclosures that provide independent enclosure of such circuits. Safety service circuits must be arranged such that a fault on any other circuit cannot be transferred to the safety service circuit.</p>
7	<p><b>FAQ 40/2011 – CLAUSE 7.2.7.2</b>  <b>CLAUSE 7.2.7.2 Wiring systems – Type of wiring</b></p> <p><b>Question 40/2011:</b> May Exception (A) to Clause 7.2.7.2 be applied to the type of wiring system used for consumers mains supplying safety services where such mains are installed within a switchroom that is constructed to provide a fire rating of at least 2 hours?</p> <p><b>Answer:</b> No. The Exception applies to wiring system enclosures that provide independent enclosure of such circuits. Safety service circuits must be arranged such that a fault on any other circuit cannot be transferred to the safety service circuit.</p>